

Challenges for Balancing Area Coordination Considering High Wind Penetration

Robin Broder Hytowitz & Dr. Ben Hobbs, *Johns Hopkins University*
Dr. Ozge Ozdemir, *Energy Research Centre of the Netherlands (ECN)*

TAIC/FERC Workshop, November 7-8 2014




Outline

- **Motivation**
- Background
- Initial Results
- Future Work




Motivation

- Renewables add variability to system operations
- Balancing area (BA) consolidation has been proposed
- Wind, load diversity reduce impact of variability
 - Better resource use
 - Reserve
 - Unit scheduling
 - Decrease peak generation & ramping needs

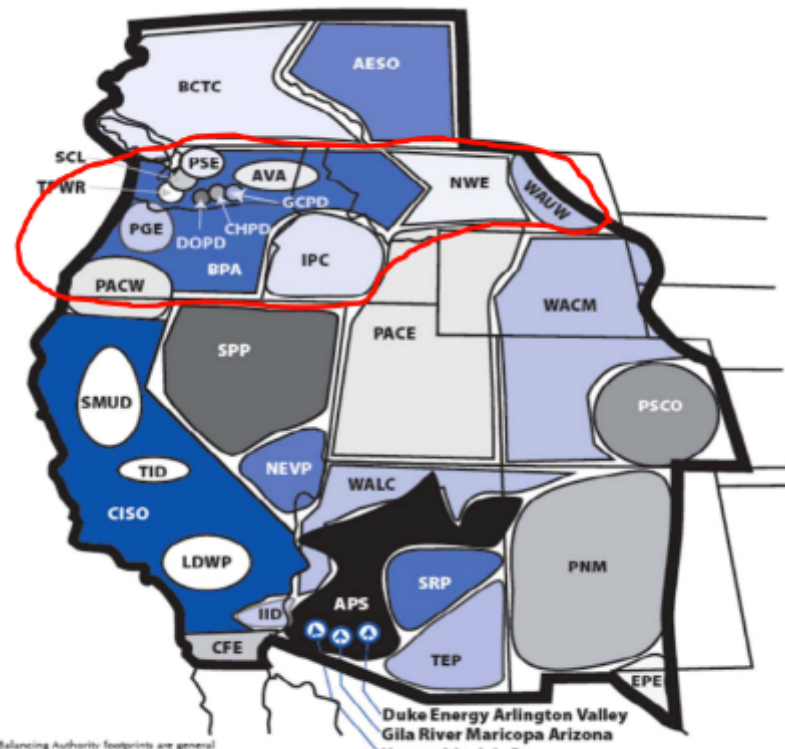

Motivation

- Tradeoffs
 - System size (more nodes & variables) makes solving to optimality more difficult
 - Increasing complexity in systems operations (ex: stochastic UC)
- Most dramatic results are seen in studies with large consolidation
- Does not address uncertainty
 - What's more valuable?
- Challenge of merging different policies, rules, and regulations

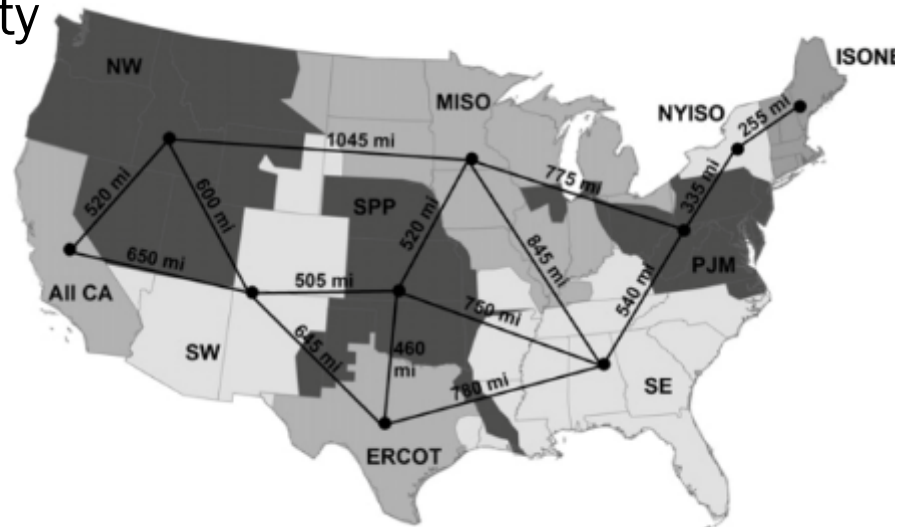

Questions

- Assuming full integration is not an option:
 - How can we incent efficient coordination & trade?
 - What coordination comes closest to integration?




Outline

- Motivation
- **Background**
- Initial Results
- Future Work



General Market Timeline

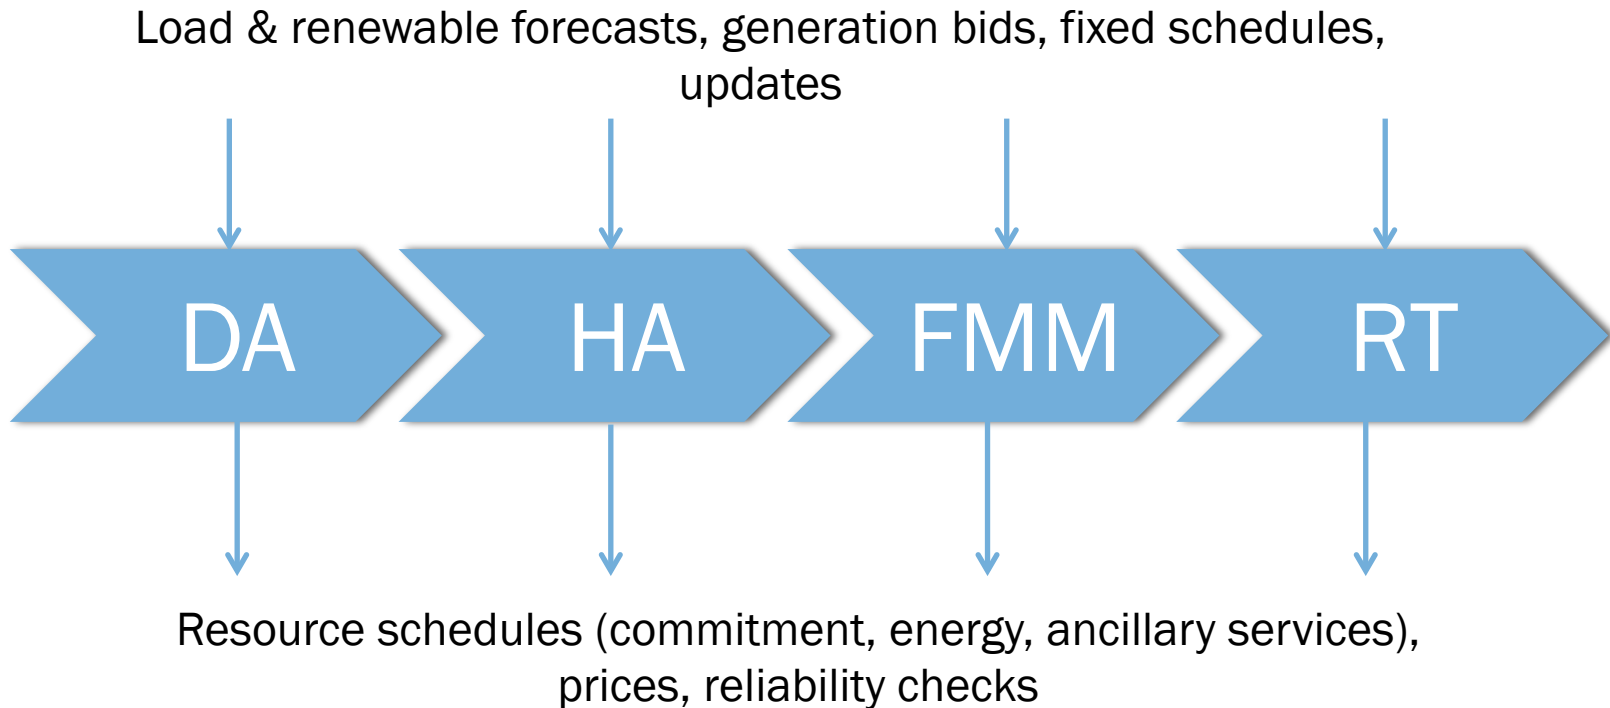

DA = Day-Ahead, HA = Hour-Ahead,
FMM = Fifteen Minute Market, RT = Real-Time



Hurdle Rates

- Definition
 - Within models, a transaction cost that represents barrier to trade between BAs
 - “Economic friction”[1]
- Parameterized to simulate actual amount of trade
 - Not actual price
- Easy to implement in model objective:

$$HR(Trade^{A \rightarrow B} + Trade^{B \rightarrow A})$$



General US Markets

BA 1

BA 2

DA


DA

RT


RT




EU Markets (non-market splitting), West Coast

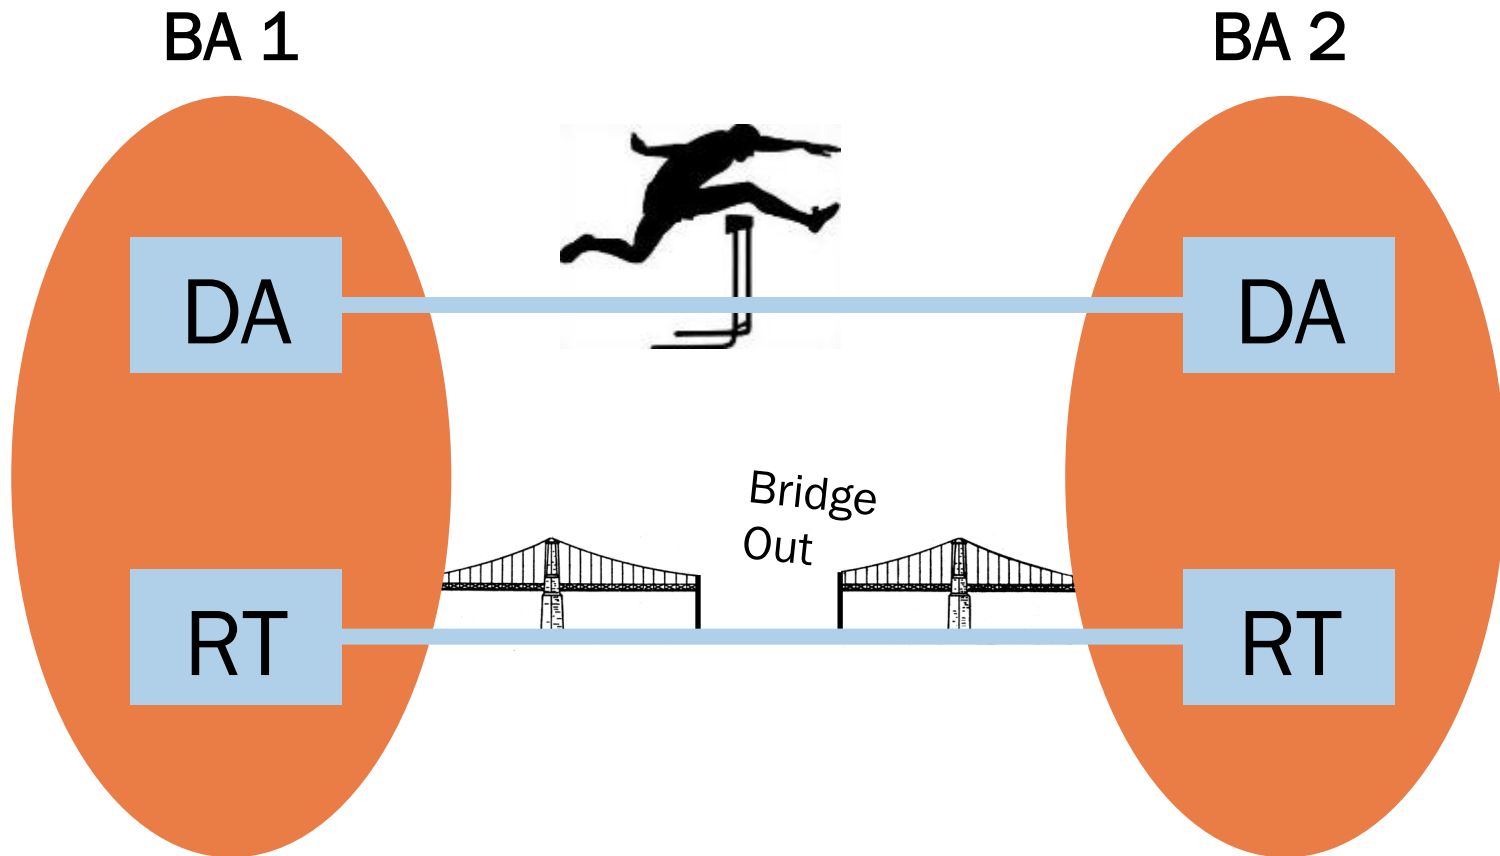


EU Market-Splitting/Coupling

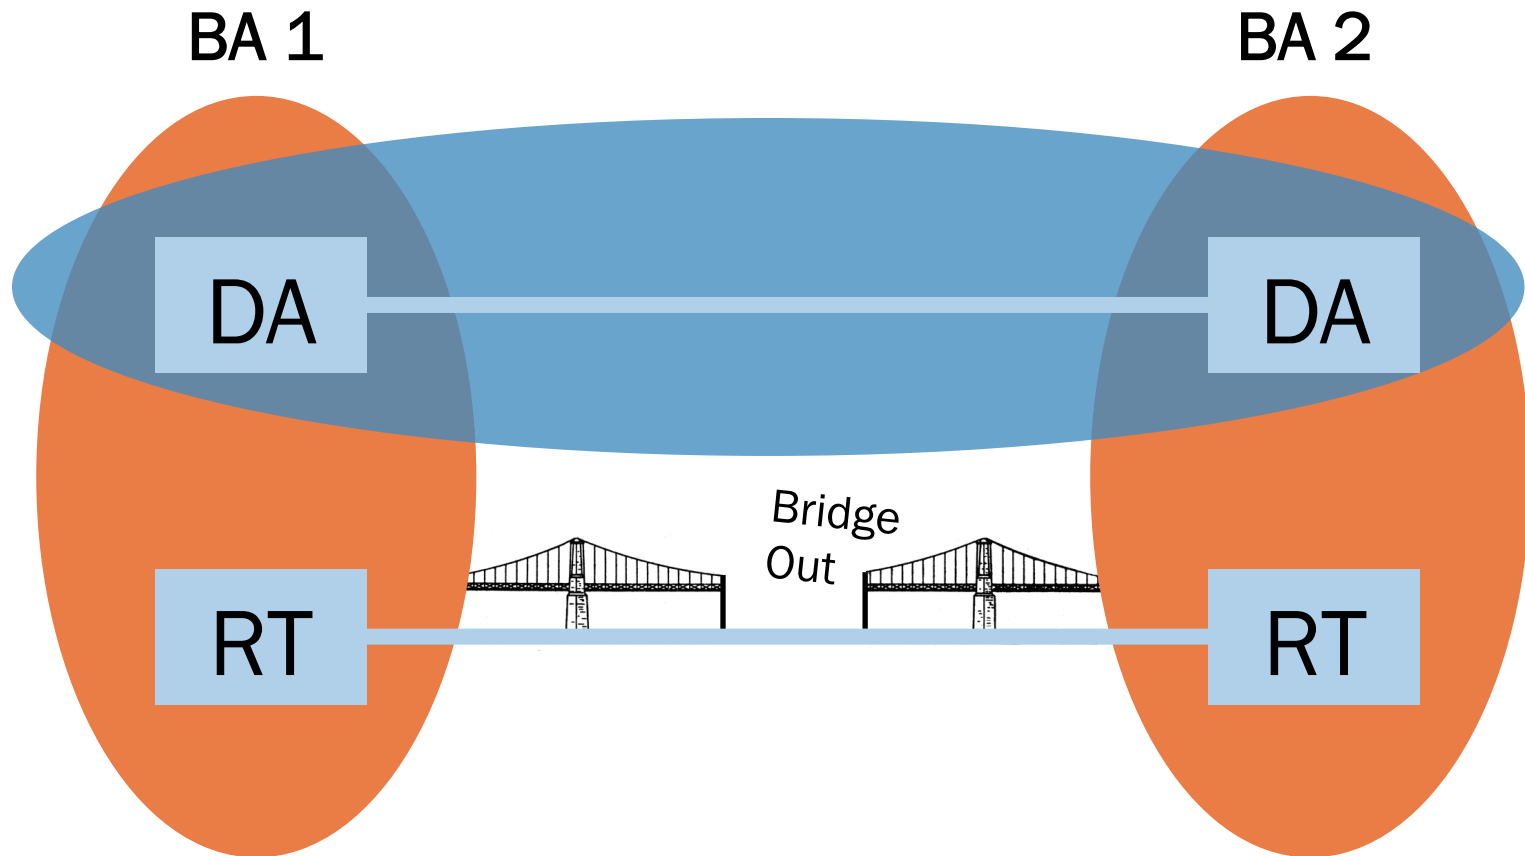


CAISO – PacifiCorp – Nevada Energy Imbalance Market (EIM)

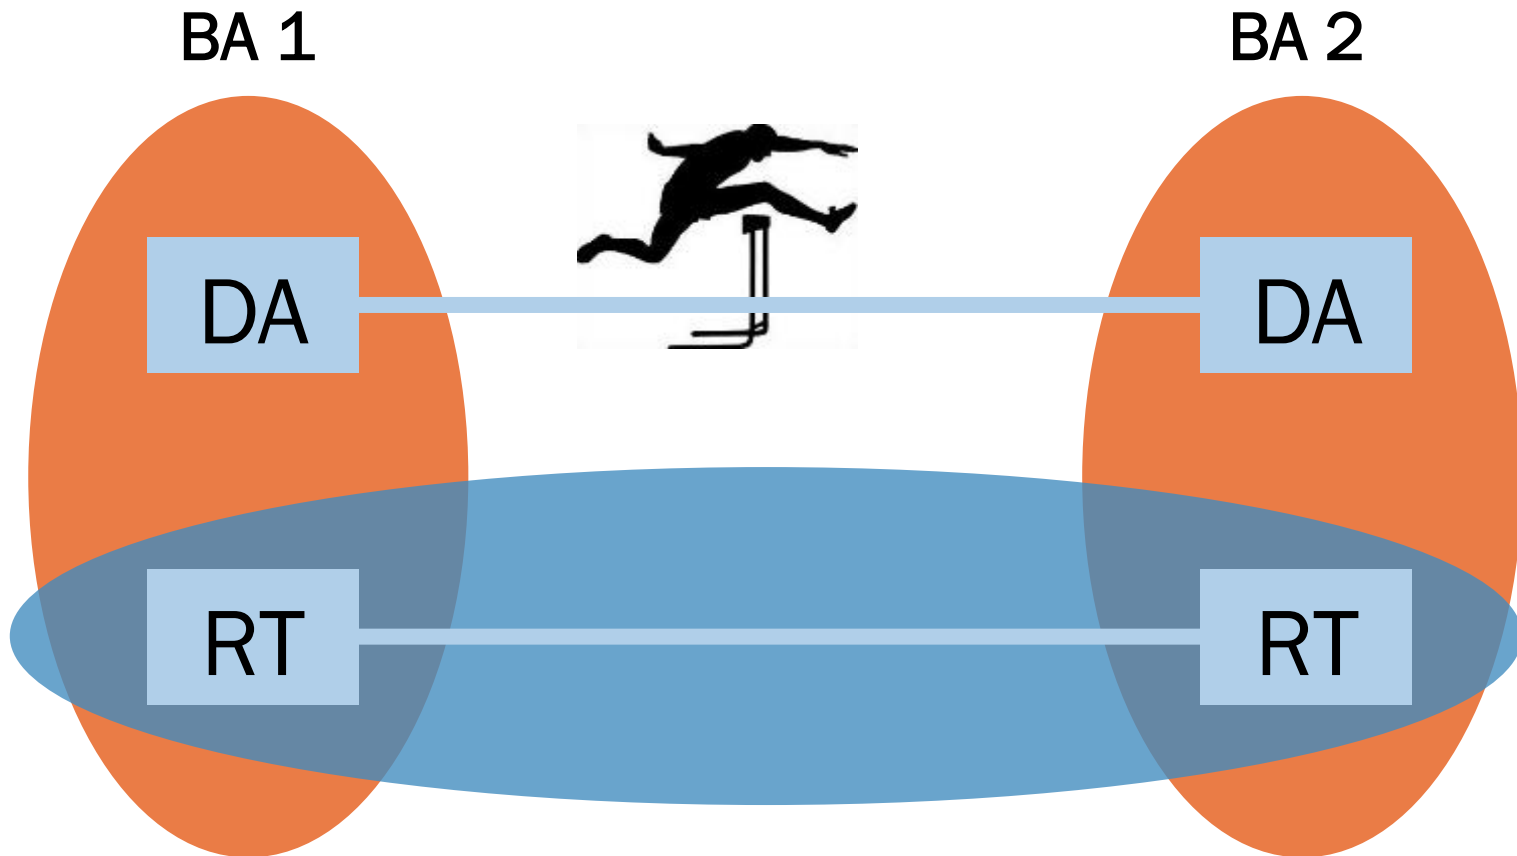

CAISO Energy Imbalance Market Details

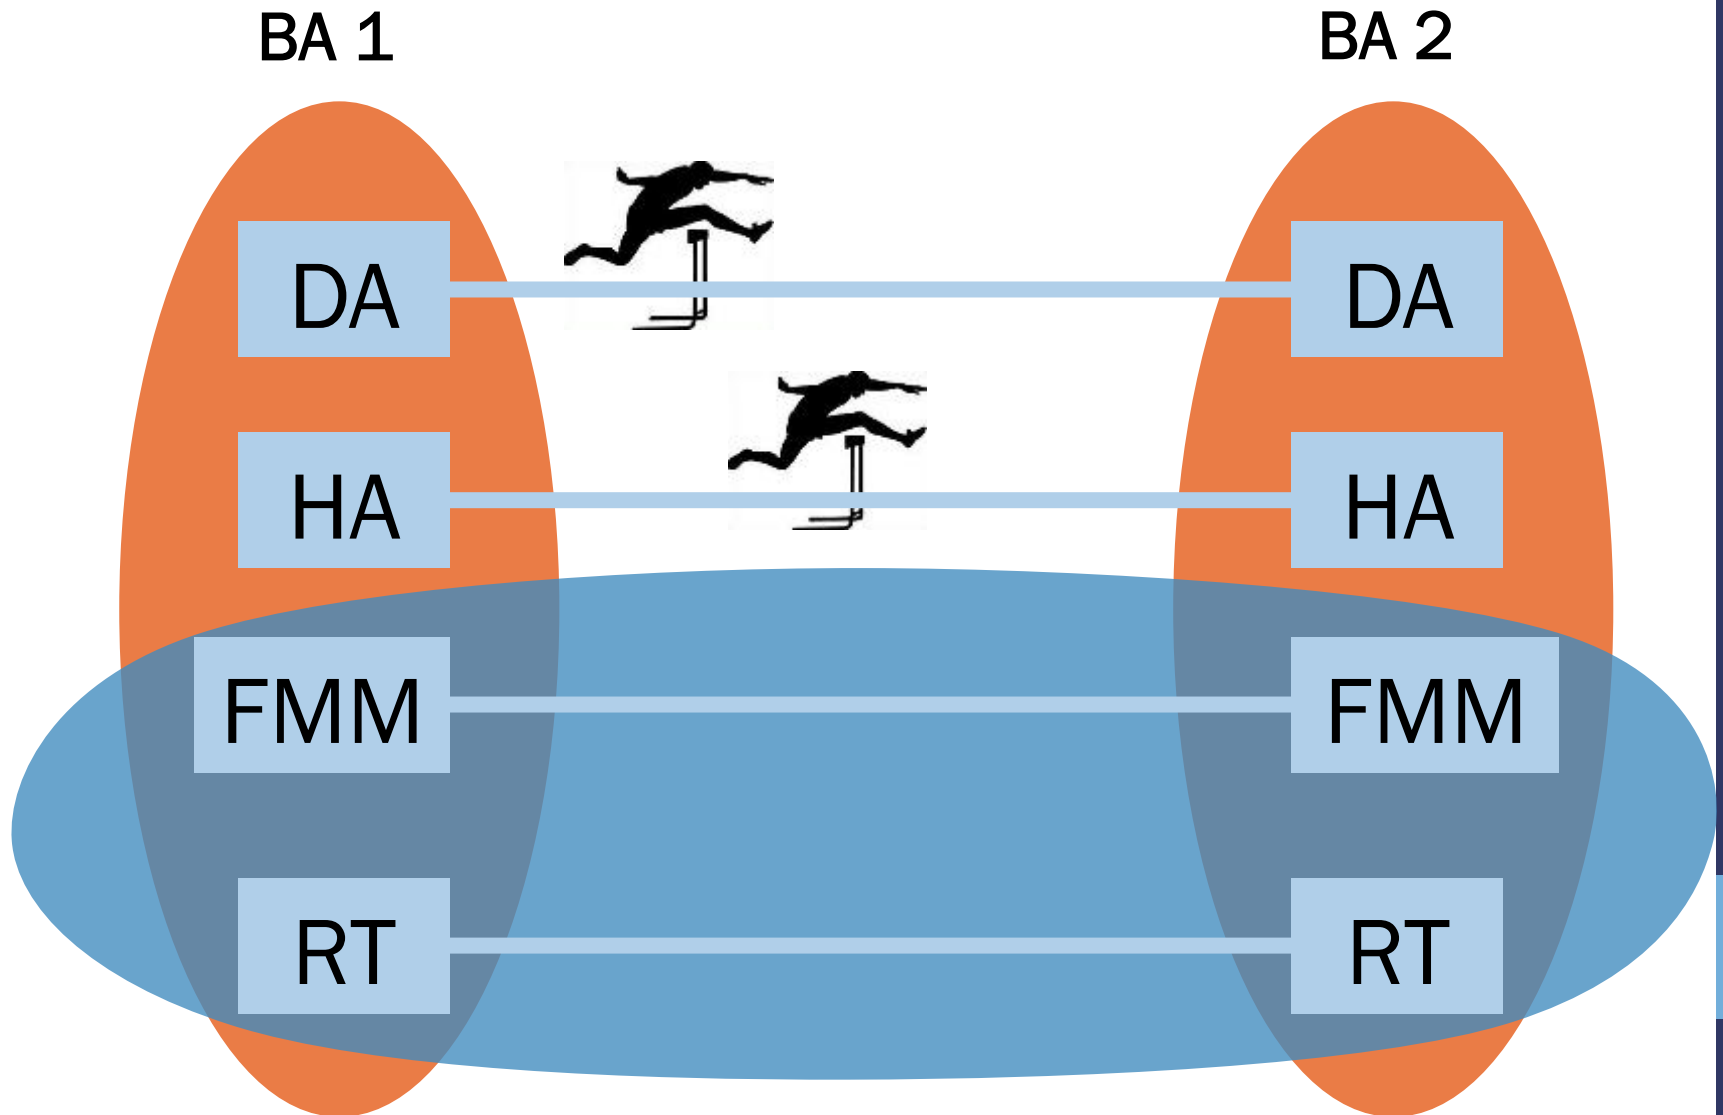

Allocation of BA Interties

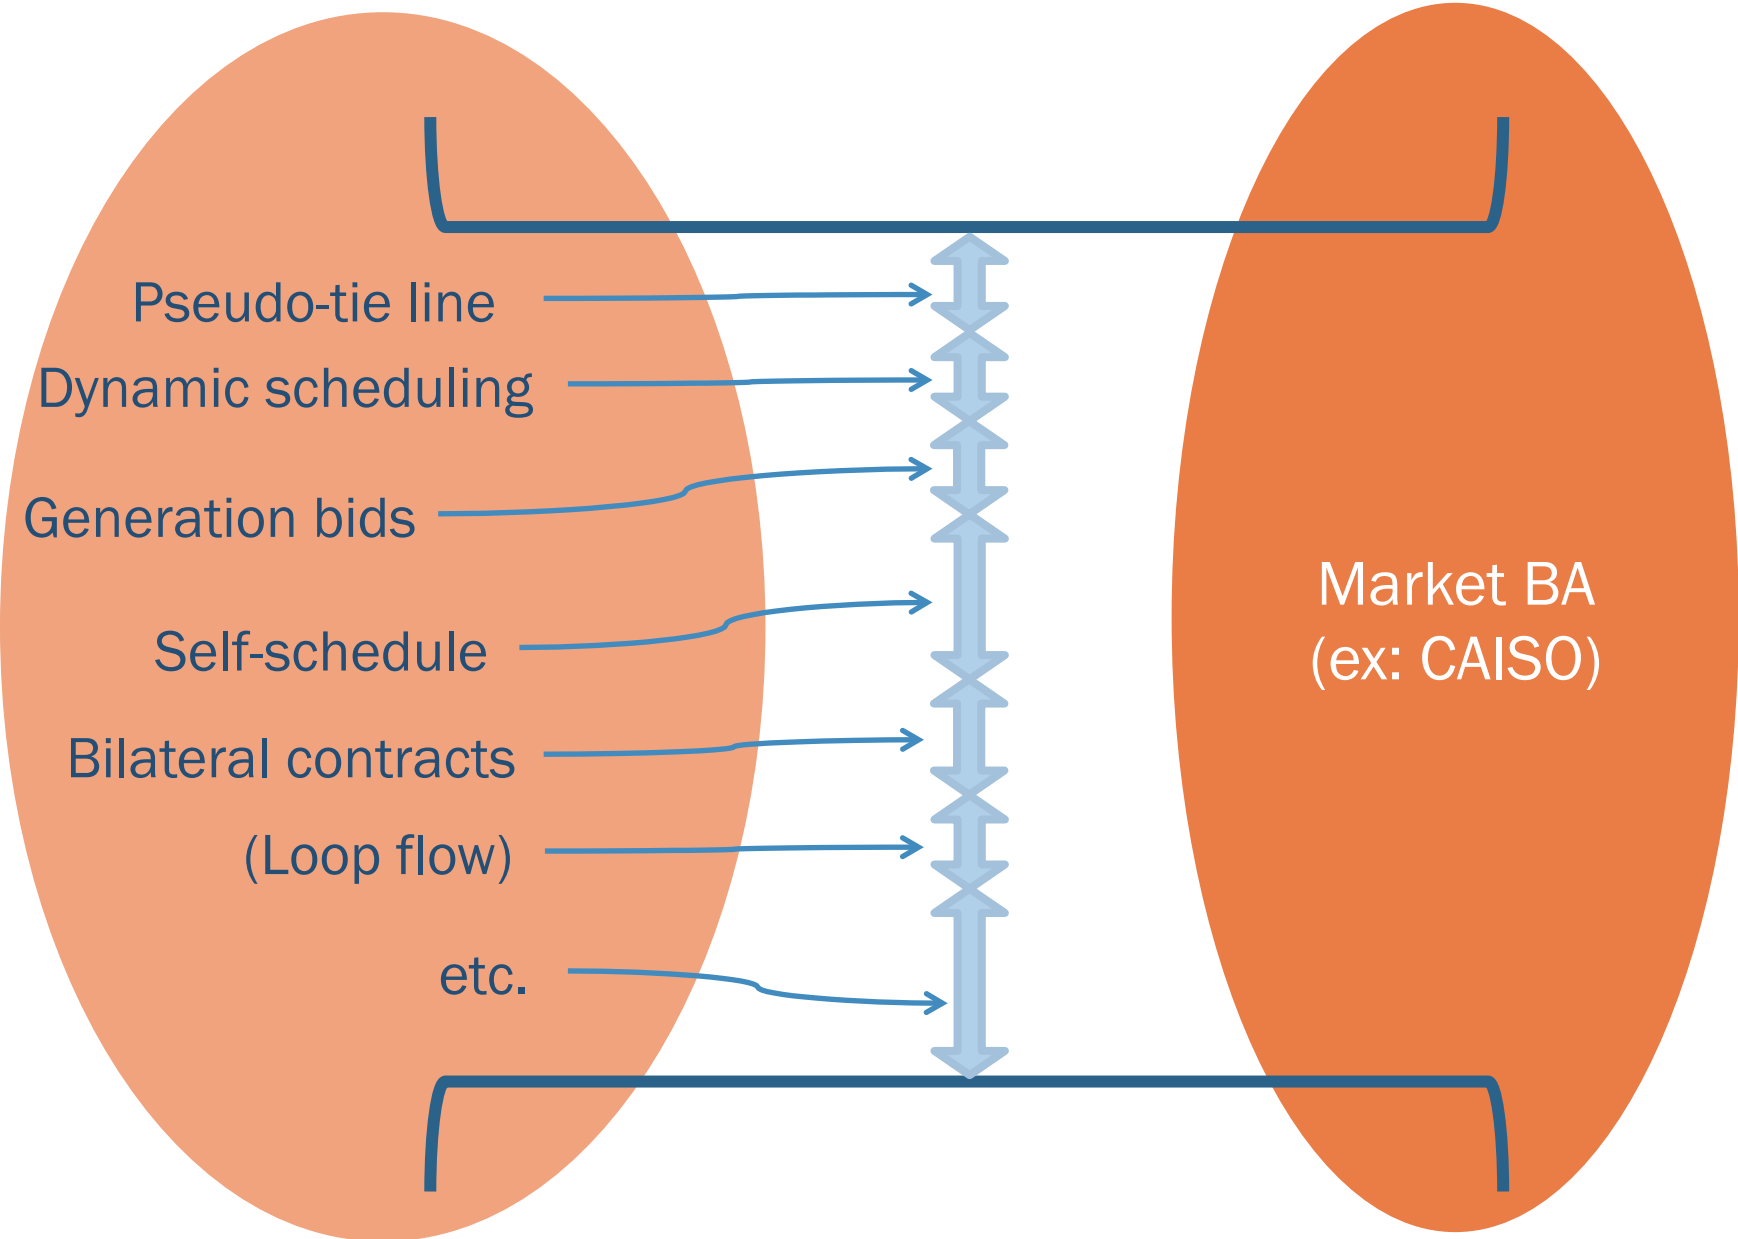

General US Markets

BA 1

BA 2

DA


DA

RT

RT



Actual Markets

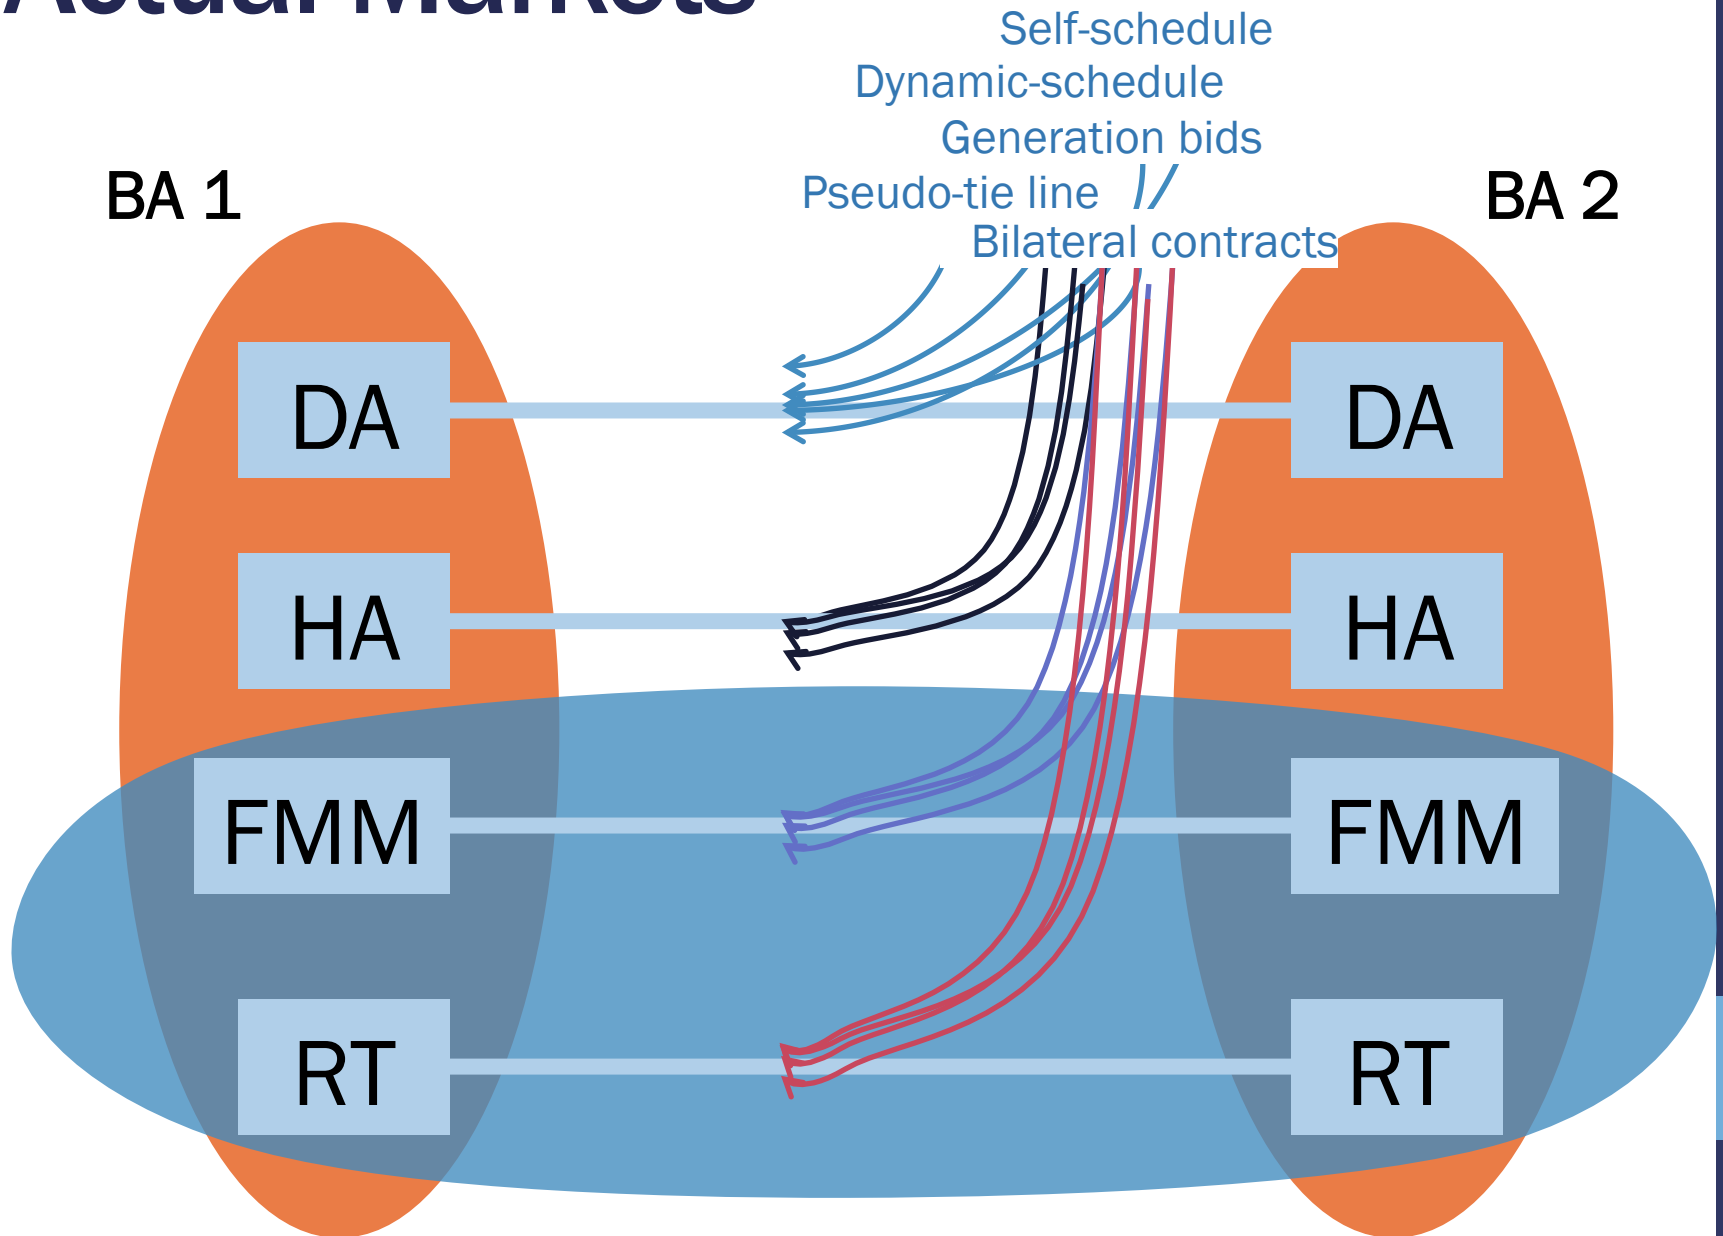

Outline

- Motivation
- Background
- **Initial Results**
- Future Work




Scenarios

		<i>Real-Time</i>		
		No Coordination	Hurdle Rate	Full Integration
<i>Day-Ahead</i>	No Coordination			
	Hurdle Rate	Old WECC, EU non-market splitting	Regional authorities	CAISO
	Full Integration	EU market splitting/coupling (Nordpool, APX)		Consolidation Single RTO



Scenarios

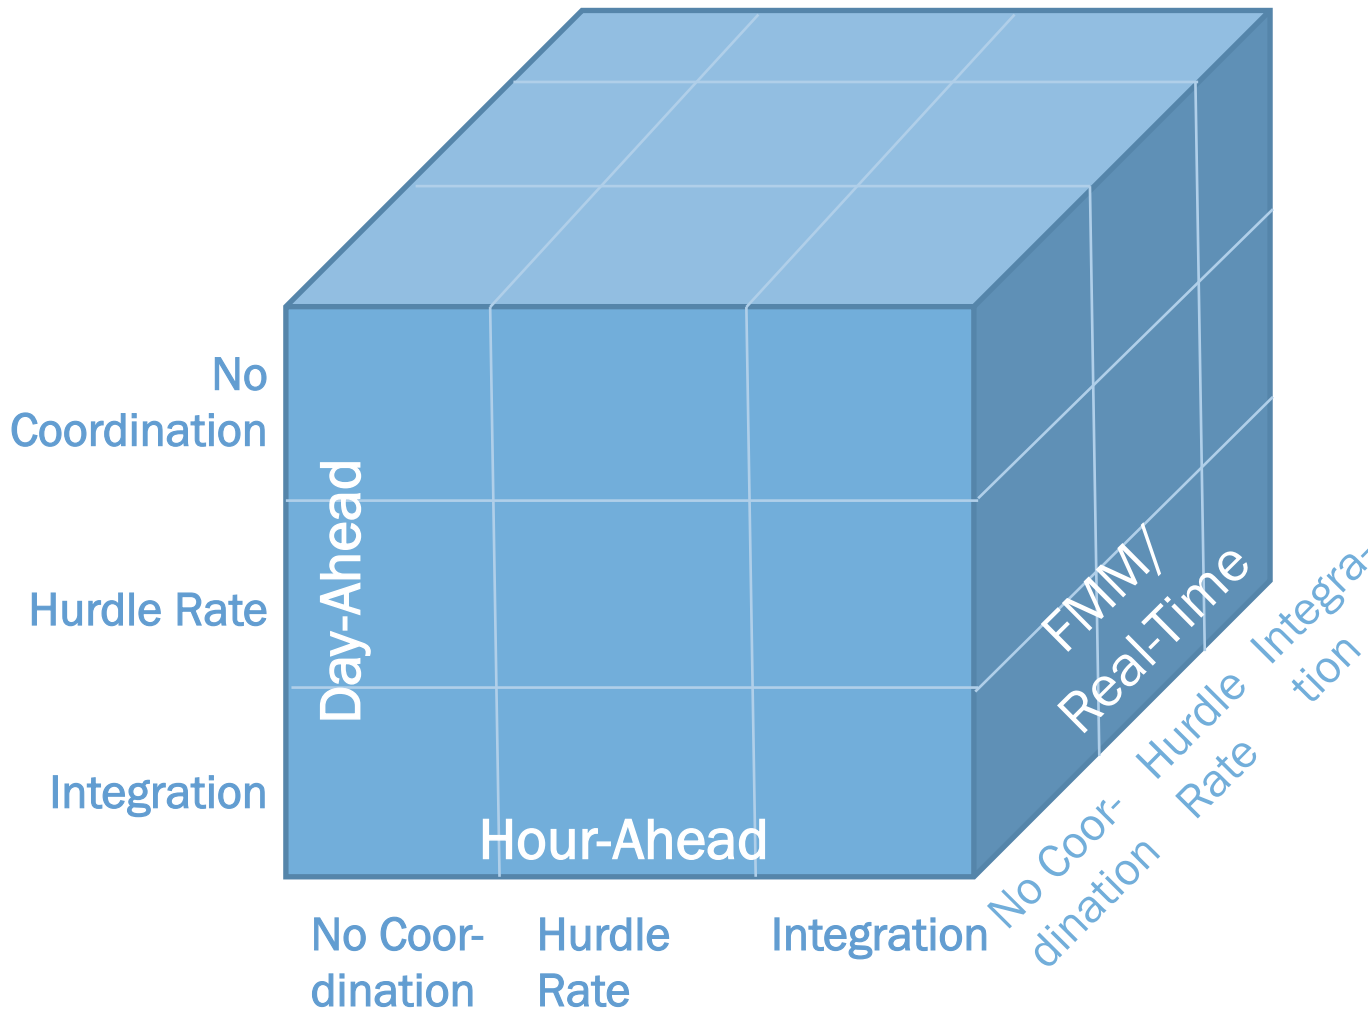

Model

- Types of models
 - *Day-ahead scheduling: unit commitment*
 - Commits generation units for the next day
 - MILP, binary decisions represent commitment
 - *Real-time model*
 - Optimizes (least cost) power flow
 - Both models:
 - Subject to transmission & generation constraints (KCL, KVL, capacity)
 - Options to curtail wind and shed load



Model: Integrated Market

Day-Ahead

$$\min \sum_{\forall t} \sum_{\forall g} c_g P_{g,t} + c_g^{SU} v_{g,t} + c_g^{NL} u_{g,t}$$

Subject to:

Line limits, transmission constraints (B θ),
capacity limits, ramp rates, minimum up & down times,
spin & non-spin reserve requirements

Real-Time

$$\min \sum_{\forall t} \sum_{\forall g} c_g P_{g,t}$$

Subject to:

Line limits, transmission constraints (B θ), capacity
limits, ramp rates, spin reserve requirements



Model: Hurdle Rate

Day-Ahead

$$\min \sum_{\forall t} \sum_{\forall g} \left(c_g P_{g,t} + c_g^{SU} v_{g,t} + c_g^{NL} u_{g,t} \right) + HR(S_t^{AB} + S_t^{BA})$$

Subject to

$$S_t^{AB} - S_t^{BA} = \sum_{\forall k \in IT} P_{k,t}^{line} \quad \forall t$$

Line limits, transmission constraints (B θ),
capacity limits, ramp rates, minimum up & down times,
spin & non-spin reserve requirements

Real-Time

$$\min \sum_{\forall t} \sum_{\forall g} \left(c_g P_{g,t} \right) + HR(S_t^{AB} + S_t^{BA})$$



Model: No Coordination

Day-Ahead

$$\min \sum_{\forall t} \sum_{\forall g} c_g P_{g,t} + c_g^{SU} v_{g,t} + c_g^{NL} u_{g,t}$$

Subject to

$$\sum_{\forall k \in IT} P_{k,t}^{line} = 0 \quad \forall t$$

Line limits, transmission constraints (B θ), capacity limits, ramp rates, minimum up & down times, *separate* spin & non-spin reserve requirements


Real-Time

$$\min \sum_{\forall t} \sum_{\forall g} c_g P_{g,t}$$




System Topography


- Reliability Test System 1996
- 3 Zone (99 generators, 73 buses)
- 24 hours
- Each BA is similar in size
 - # generators
 - Type of generation
 - Wind capacity

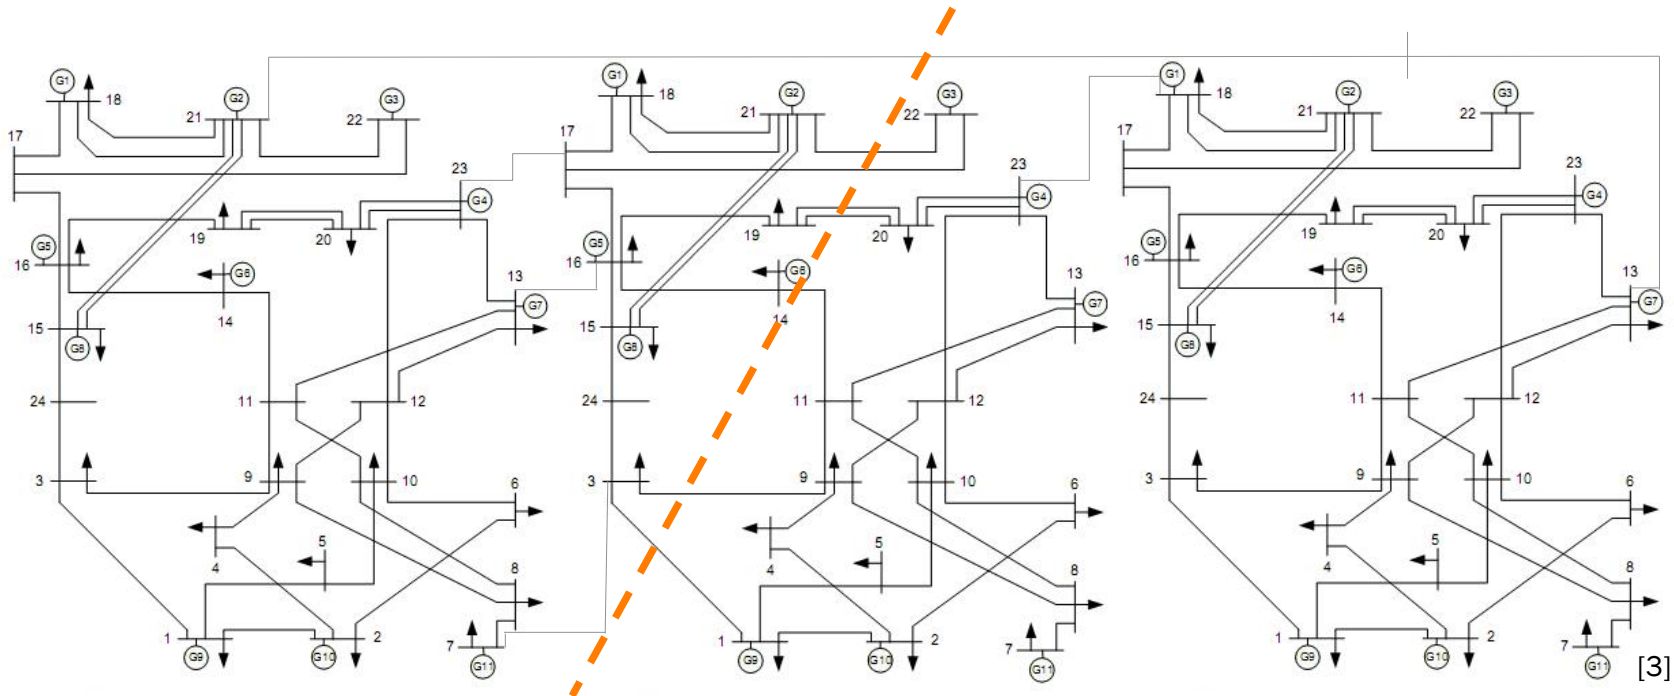


Results – Real Time Costs

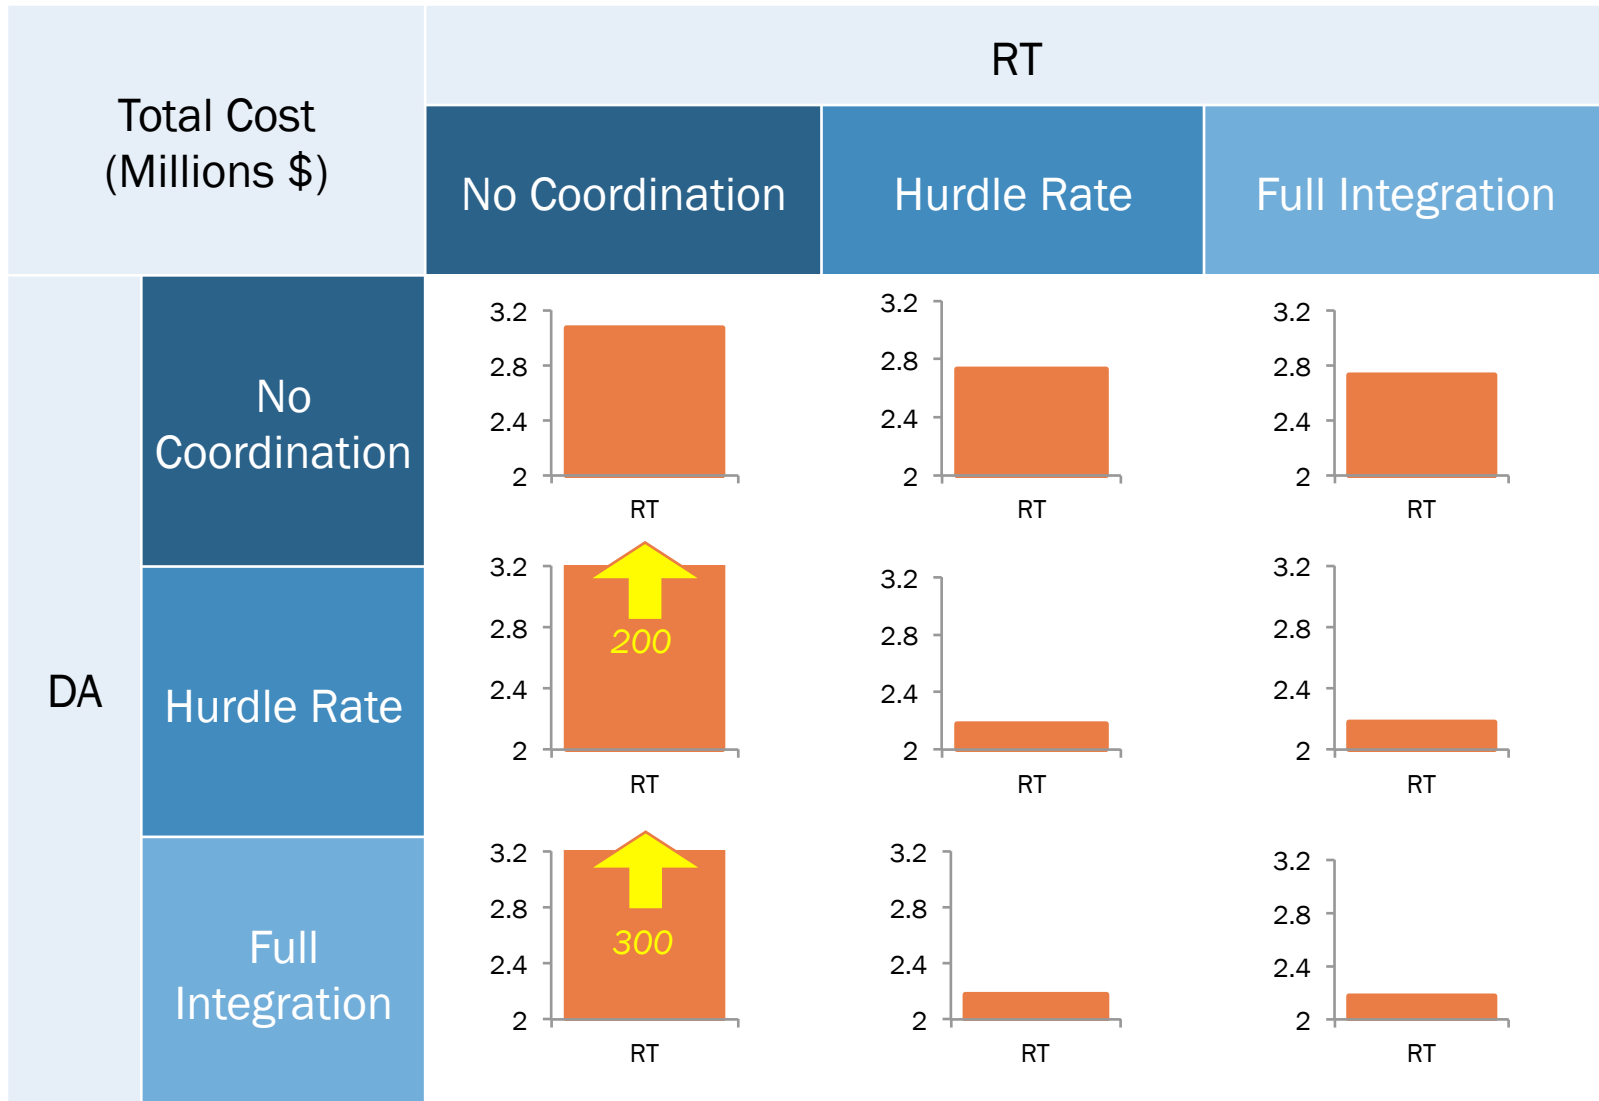


Results – Prices

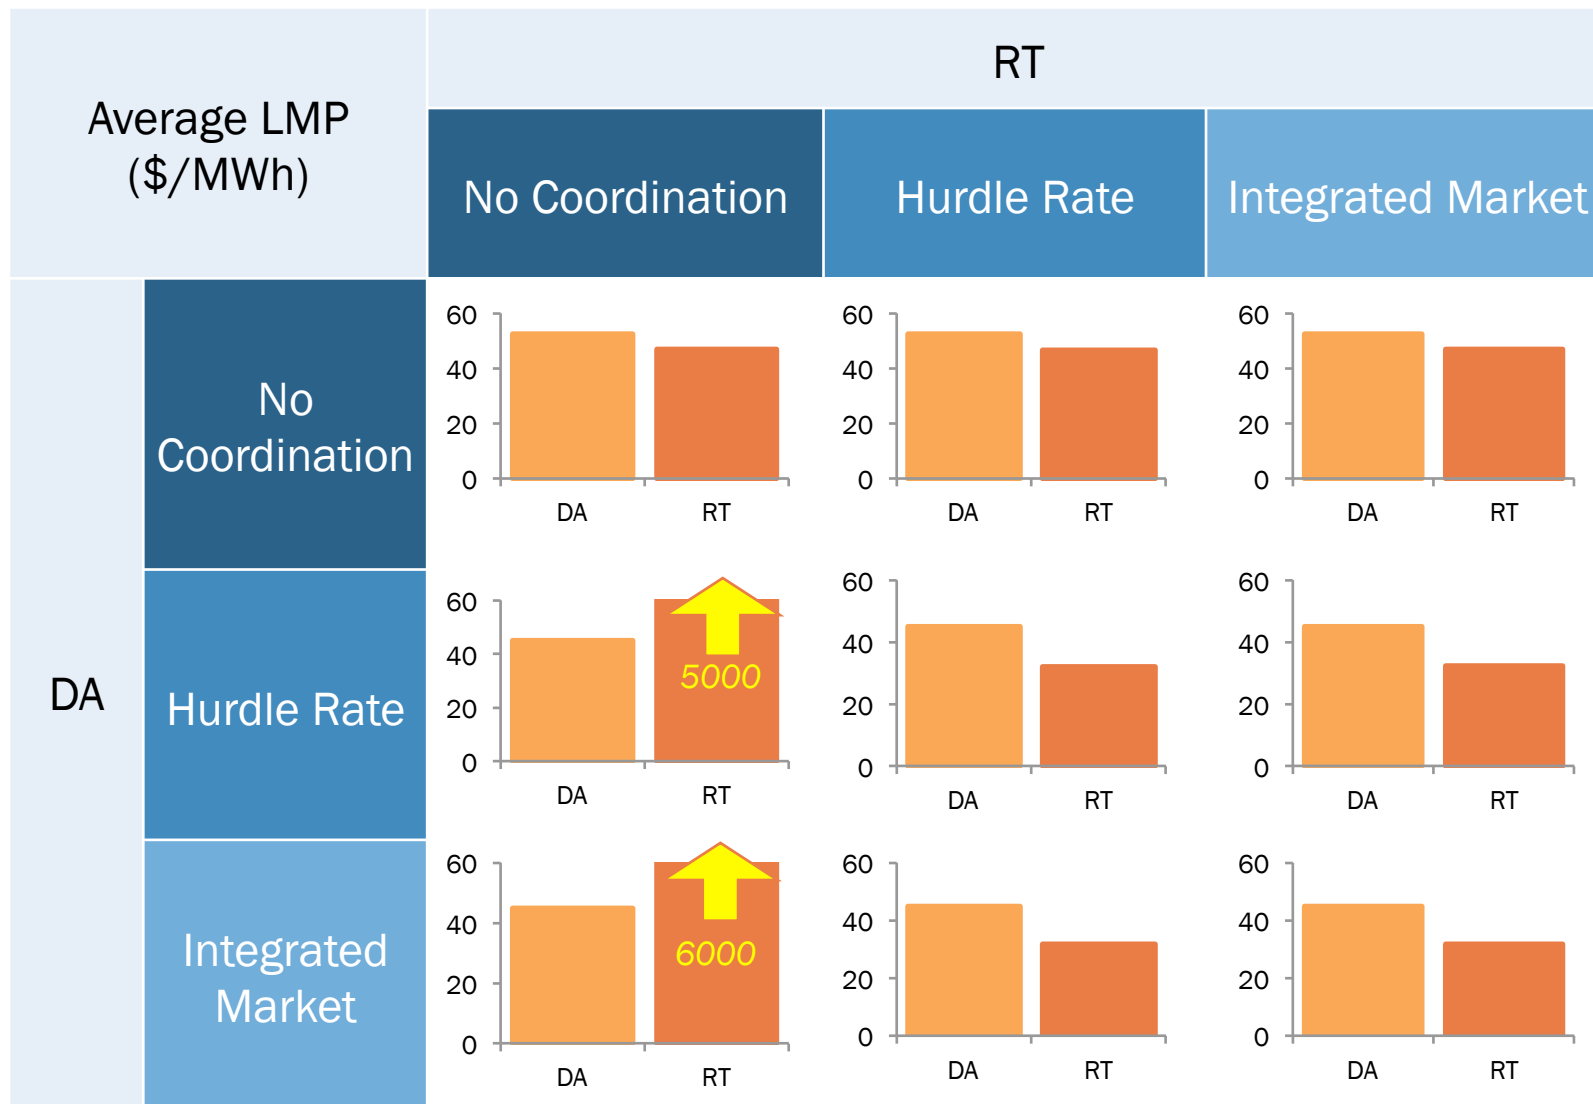


Results - deterministic and stochastic wind scenarios

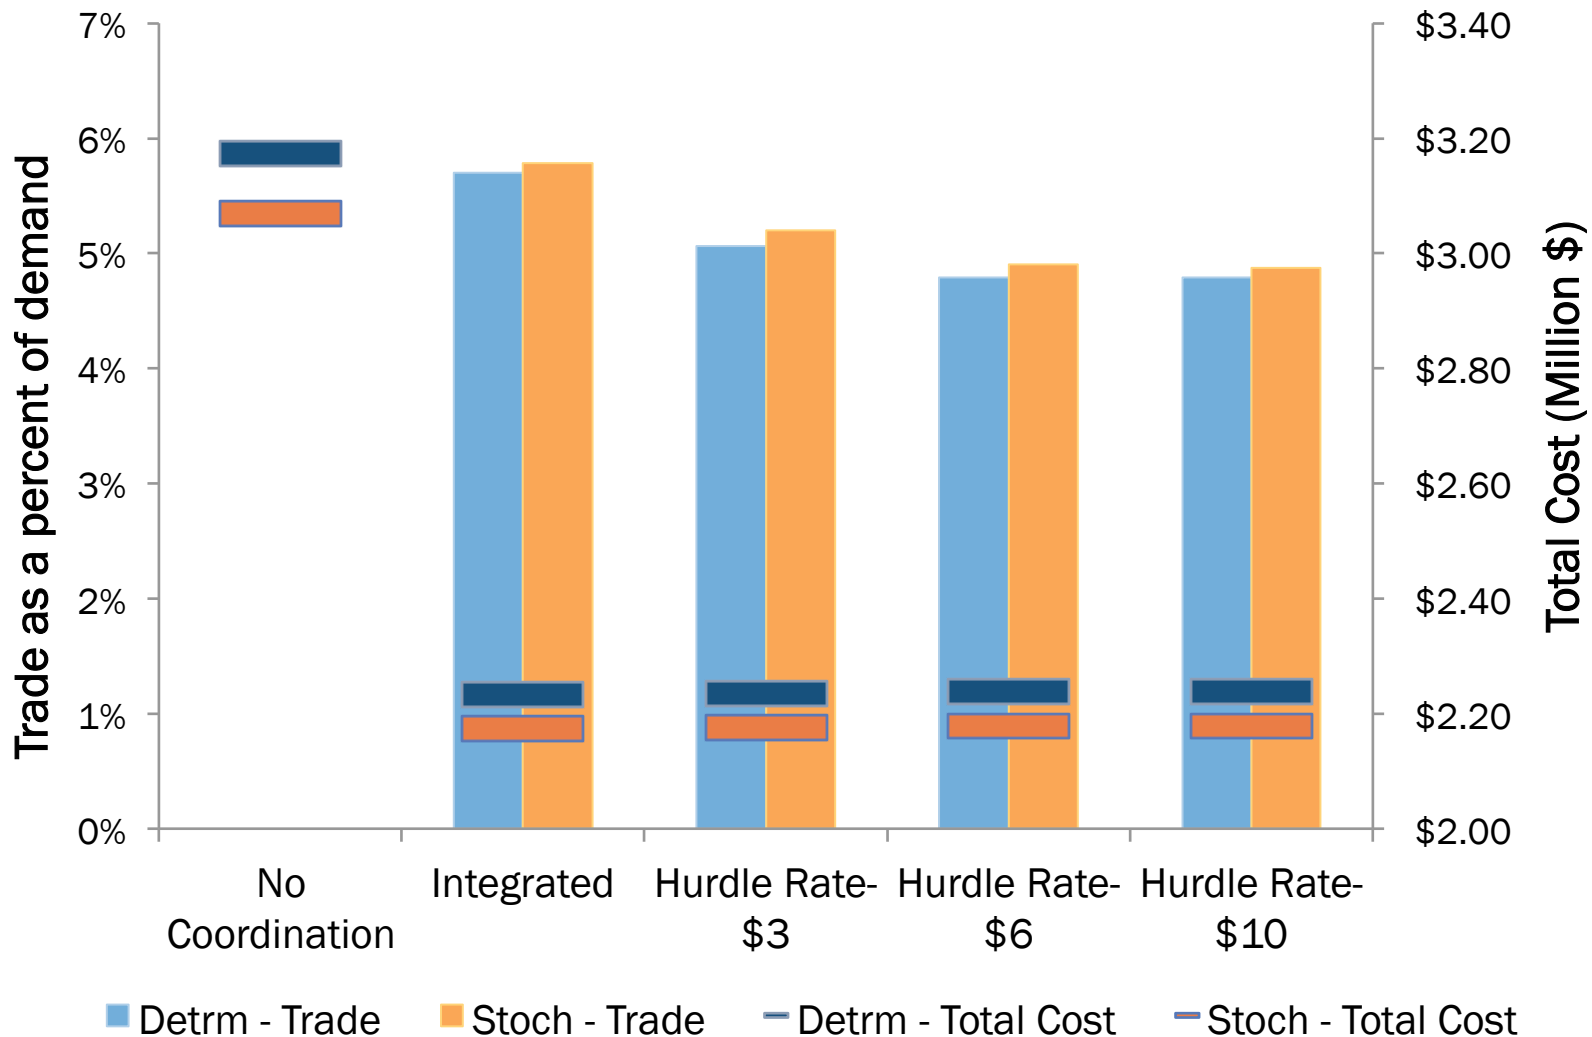

Price results – single wind forecast

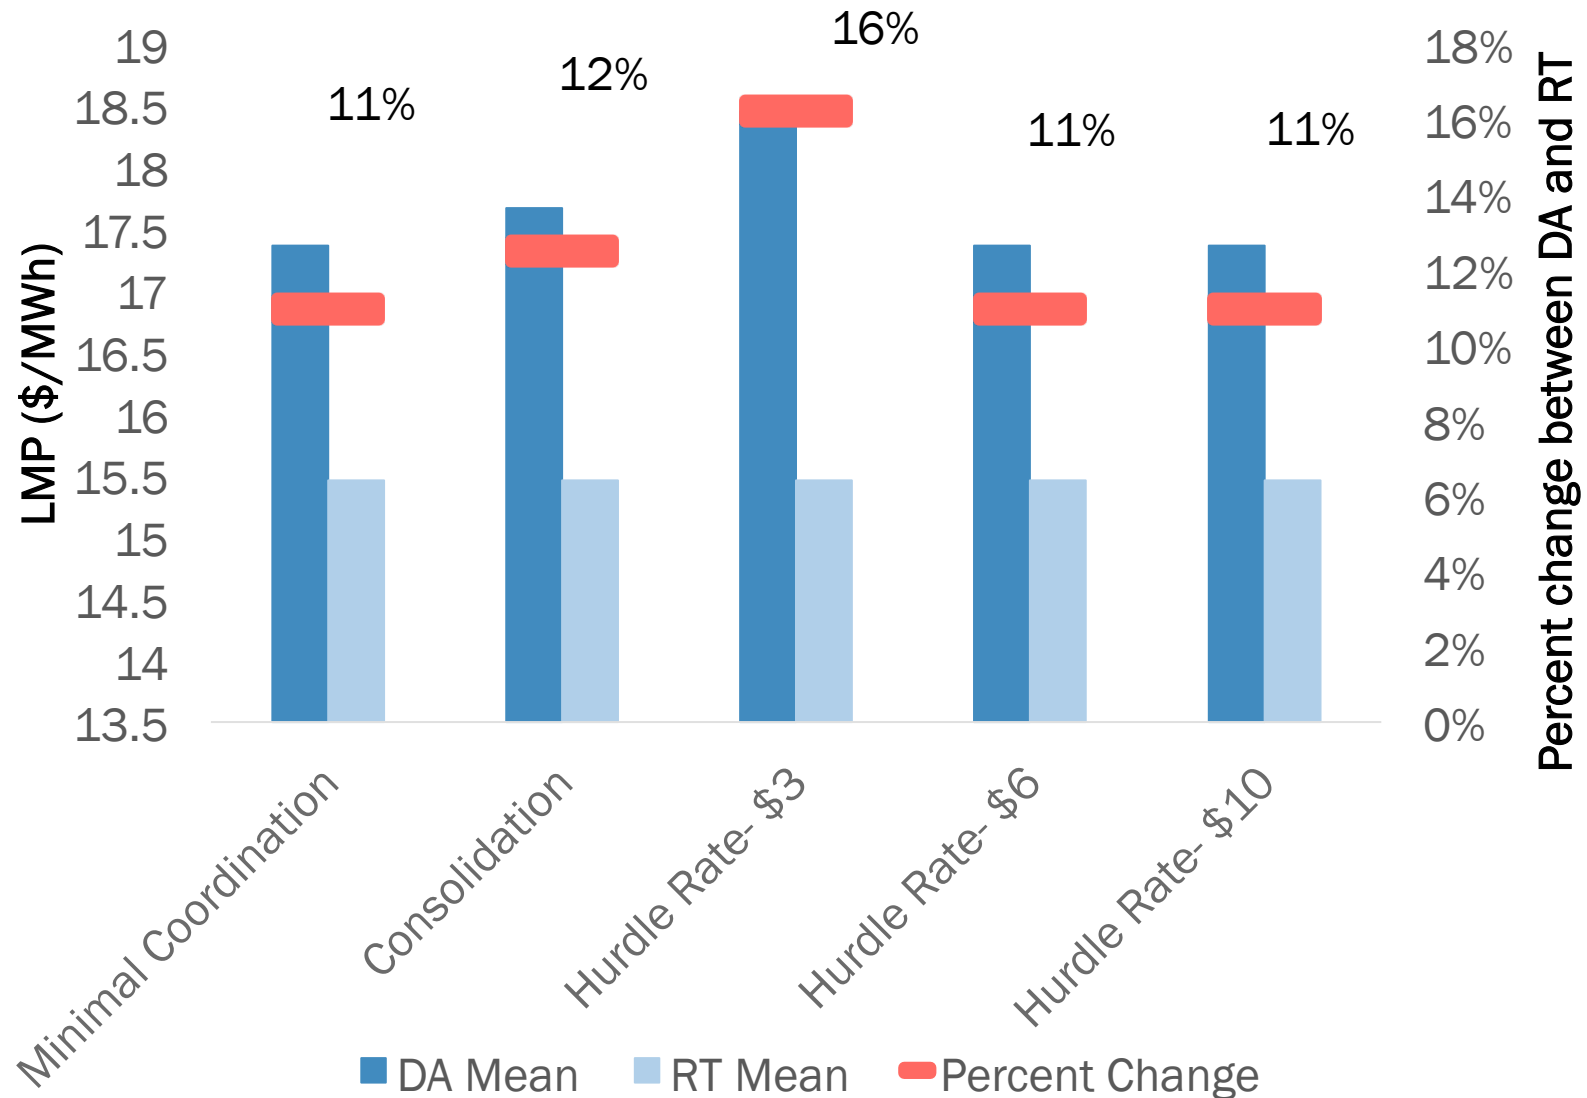

Results – All scenarios

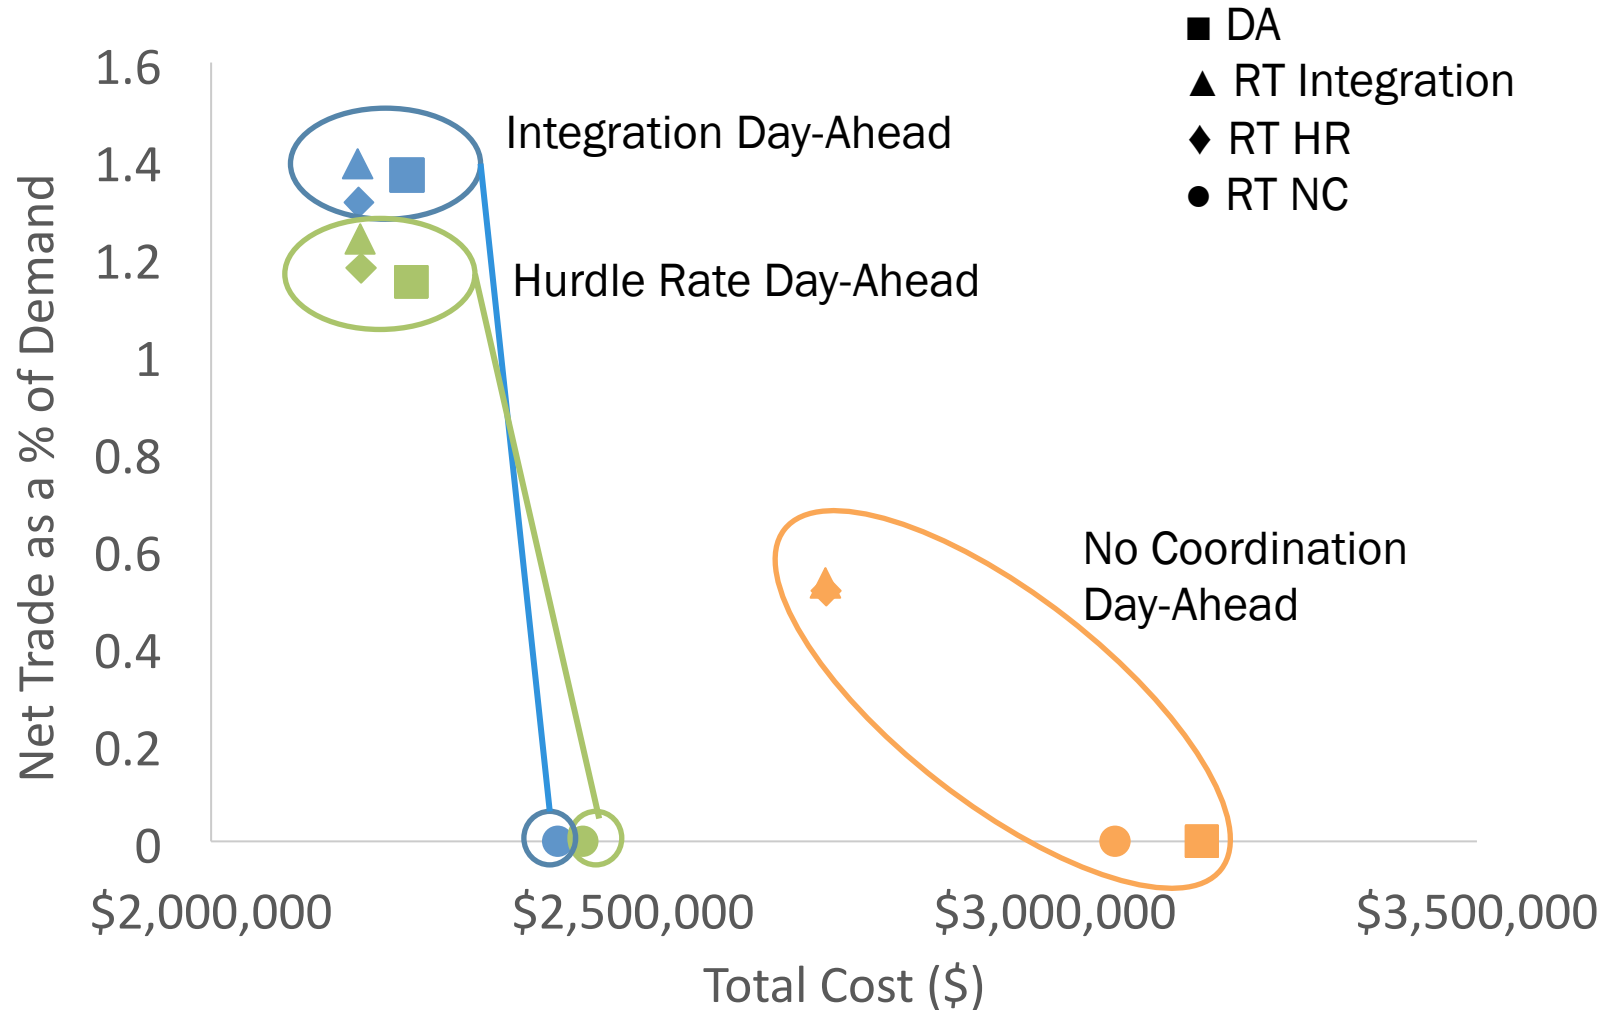

Conclusions

- Integrated markets yield most gains from trade
 - Barriers on interties impede efficient markets
 - Going from no coordination to hurdle rates makes large difference
 - Further lowering hurdle rates most beneficial in DA rather than RT
- Further work needed to determine the simplifying effect of hurdle rates relative to actual barriers
 - Which barriers are most important to address?
 - Who should be responsible for removing inefficiencies?
- When no RT coordination, there might not be enough generation on-line to meet demand
- Average prices more consistent DA vs RT when there is no coordination day-ahead



Outline

- Motivation
- Background
- Initial Results
- **Future Work**



Future Work

- Different size BAs, different generation mix
- Modeling specific barriers on the intertie line
 - Self-scheduling
 - Dynamic-scheduling
- COMPETES model – ECN
 - Look at European grid
- Additional balancing areas
- Greatest benefits for renewables



Thank you!

Questions?

Email: hytowitz@jhu.edu



References

- [1] Joseph H. Eto, Douglas R. Hale and Bernard C. Lesieutre, “Toward More Comprehensive Assessments of FERC Electricity Restructuring Policies: A Review of Recent Benefit-Cost Studies of RTOs” *The Electricity Journal*
- [2] Frank Wolack, “The Economics of Self Scheduling,” Presentation available: <http://www.caiso.com/Documents/Presentation-Economics-Self-Scheduling-MSCPresentation.pdf>
- [3] Jesús María López-Lezama, Mauricio Granada-Echeverri, and Luis A. Gallego-Pareja, “A combined pool/bilateral dispatch model for electricity markets with security constraints” *Ingeniería y Ciencia*, June 2011.

